



## BOILERS AND ANCILLARY EQUIPMENT



Waste Management City of Nuremberg  
Waste incineration plant Nuremberg  
Revision steam generator  
March - October 2020

Uniper KW GmbH  
Lignite-fired power plant in Schkopau  
Change of superheater heating surface  
June - July 2020



BASF Antwerp  
GuD power plant in Antwerp  
Repair of steam boiler  
July - August 2020



RWE Huckingen power station  
TÜV programme Boiler pressure part and replacement of  
the fuel injection cooler  
16Mo3, 13CrMo4-5, 10CrMo9-10  
5,000 hours  
September - October 2019





## BOILERS AND ANCILLARY EQUIPMENT




**Pfeifer&Langen**  
**Appeldorn plant**  
 Replacement superheater 1 and 2  
 16Mo3, 10CrMo9-10  
 3,700 hours  
 June - July 2019

**USG Utility Support Group**  
**Chemelot Chemical Park, Geleen**  
 Supply of Morlock butterfly dampers type L-D  
 Material S235JR  
 Dimension lw. 3000 x 3000  
 2019



**Schicks GmbH, Greifswald**  
 Tandem damper type LT-LL  
 Material 16Mo3  
 Dimension lw. 4220 x 2220  
 2012

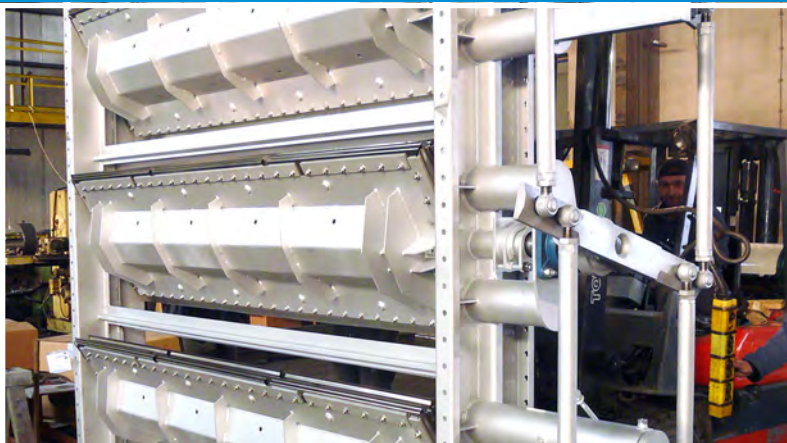


**Refinery Heide GmbH, Hemmingstedt**  
 Double damper type-0  
 Material 1.4571  
 Dimension lw. Ø 900  
 2019






## BOILERS AND ANCILLARY EQUIPMENT

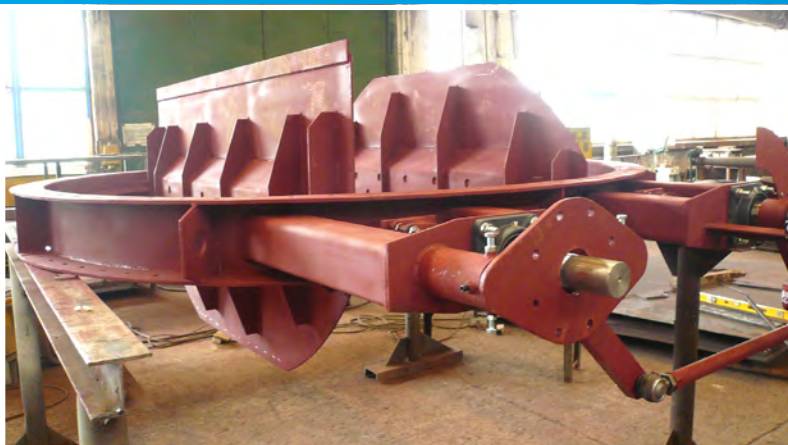

Alstom R0  
Tecnoarmit  
Butterfly Damper Type L  
Material S235JR  
Dimension lw. Ø 2500  
2011

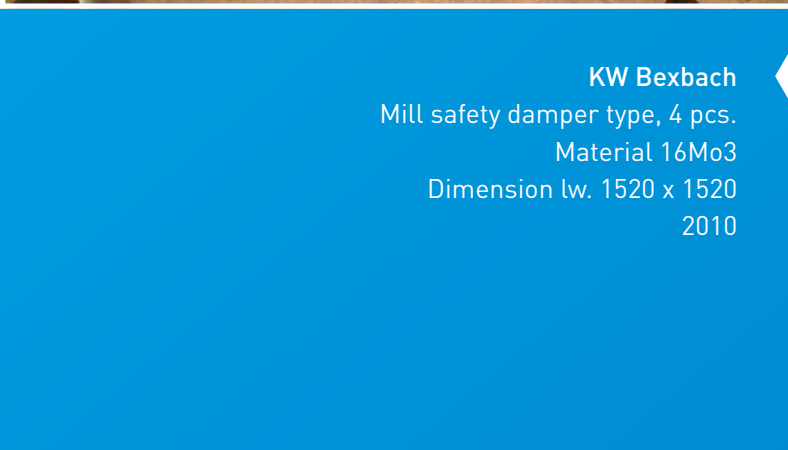

KW Bexbach  
Mill safety damper type, 4 pcs.  
Material 16Mo3  
Dimension lw. 1520 x 1520  
2010



Mehldau & Steinfahrt, Wesseling  
Control damper type L  
Material S235JR  
Dimension lw. Ø 800  
2012



Heat Hamburg  
Tiefstack combined heat and power plant  
Revision and refurbishment work on Luvo/Gavo  
3,800 hours  
August - September 2020






## BOILERS AND ANCILLARY EQUIPMENT




**Heat Hamburg**  
**Wedel combined heat and power plant**  
 Revision and renovation work on Luvo/Gavo  
 2.400 h  
 May - July 2020

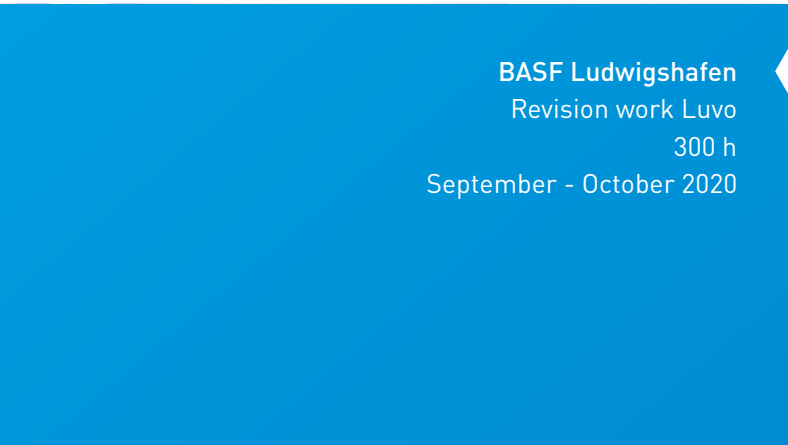

**BASF Ludwigshafen**  
 Revision work Luvo  
 300 h  
 September - October 2020



**Chemical industry in Wesseling**  
 Revision work Luvo pickling sheet replacement  
 2,500 hours  
 March - May 2020

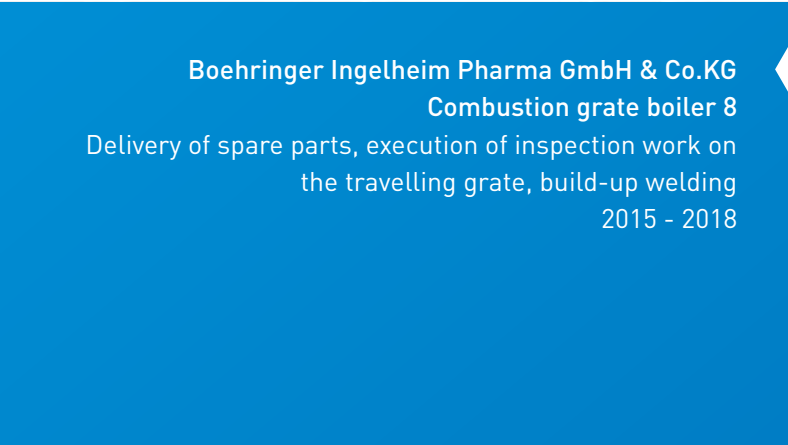


**Boehringer Ingelheim Pharma GmbH & Co.KG**  
**Combustion grate boiler 8**  
 Delivery of spare parts, execution of inspection work on the travelling grate, build-up welding  
 2015 - 2018





## BOILERS AND ANCILLARY EQUIPMENT

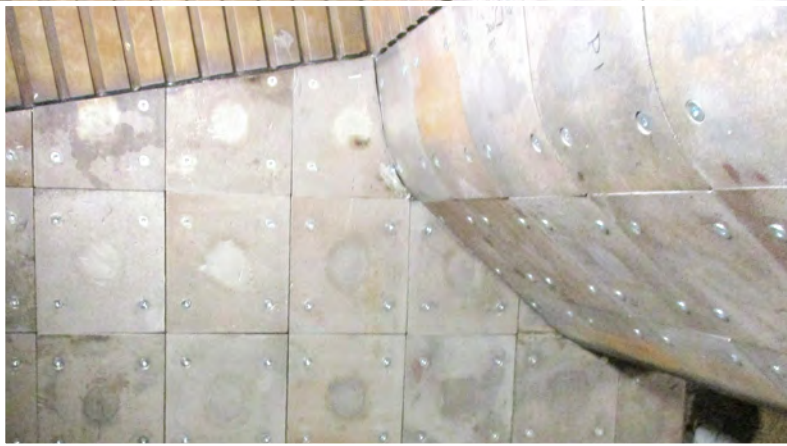


### Solingen Technical Works MHKW Solingen, boiler 1

Renewal of feed chute MK 1, cold and warm commis-  
sioning

February/March 2018

### MVV Environment Asset GmbH TREA Leuna, Line 2

Replacement of waste feed section chute compensator  
and replacement of front wall water-cooled chute  
January 2018

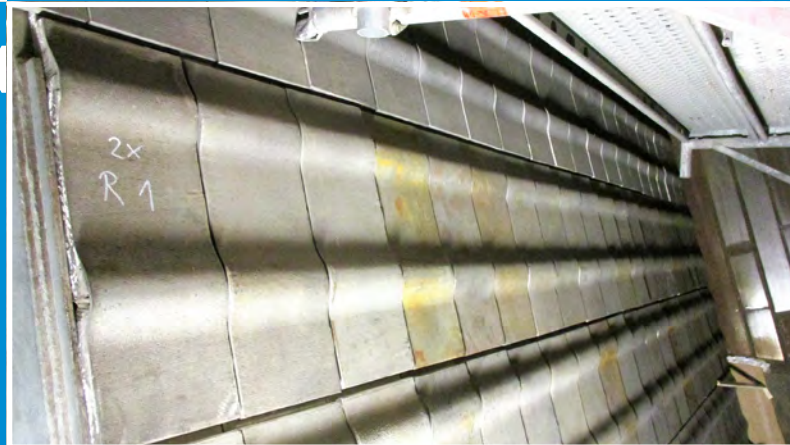

### EnBW Energie Baden-Württemberg AG MHKW Stuttgart-Münster, Boiler 26

Steam generator with roller grate firing system

Carrying out overhaul work on ram feed, feed grate and  
slag discharge

2017 until 2020



### Zanders GmbH, plant Bergisch-Gladbach Steam generator with travelling grate firing, boiler 5

Delivery of spare parts, performance of revision work on  
the travelling grate, replacement of defective shift height  
regulator, refurbishment of steel substructure

2015 - 2017

